2018 Annual Groundwater Monitoring and Corrective Action Report

Wood River Primary East Ash Pond – CCR Unit ID 901
Wood River Power Station
1 Chessen Lane
Alton, Illinois 62202

Dynegy Midwest Generation, LLC

January 31, 2019



JANUARY 31, 2019 | PROJECT #70095

OBG

2018 Annual Groundwater Monitoring and Corrective Action Report

Wood River Primary East Ash Pond – CCR Unit ID 901
Wood River Power Station
Alton, Illinois

Prepared for:

Dynegy Midwest Generation, LLC

RACHEL A. BANOFF
Environmental Engineer

ACOB J. WAŁCZAK, PG Hydrogeologist

WOOD RIVER PRIMARY EAST ASH POND 2018 ANNUAL GROUNDWATER MONITORING AND CORRECTIVE ACTION REPORT

TABLE OF CONTENTS

List of Figures	. i
List of Tables	. i
Acronyms and Abbreviations	ii
Section 1: Introduction	1
Section 2: Monitoring and Corrective Action Program Status	2
Section 3: Key Actions Completed in 2018	3
Section 4: Problems Encountered and Actions to Resolve the Problems	4
Section 5: Key Activities Planned for 2019	5
References	6

LIST OF FIGURES

Figure 1 Groundwater Sampling Well Location Map

LIST OF TABLES

Table 1	Statistical Background Values
Table 2	Groundwater Protection Standards
Table 3	Appendix III Analytical Results
Table 4	Appendix IV Analytical Results



WOOD RIVER PRIMARY EAST ASH POND 2018 ANNUAL GROUNDWATER MONITORING AND CORRECTIVE ACTION REPORT

ACRONYMS AND ABBREVIATIONS

CCR Coal Combustion Residuals
CFR Code of Federal Regulations

GWPS Groundwater Protection Standard

mg/L milligrams per liter

NRT/OBG Natural Resource Technology, an OBG Company OBG O'Brien & Gere Engineers, part of Ramboll

pCi/L picoCuries per liter

SSI Statistically Significant Increase
SSL Statistically Significant Level

S.U. Standard Units

TDS Total Dissolved Solids



SECTION 1: INTRODUCTION

This report has been prepared on behalf of Dynegy Midwest Generation, LLC by O'Brien & Gere Engineers, part of Ramboll (OBG), to provide the information required by the Code of Federal Regulations (CFR) found in 40 CFR 257.90(e) for the Wood River Primary East Ash Pond located at Wood River Power Station near Alton, Illinois.

In accordance with 40 CFR § 257.90(e), the owner or operator of an existing Coal Combustion Residuals (CCR) unit must prepare an annual groundwater monitoring and corrective action report, for the preceding calendar year, that documents the status of the groundwater monitoring and corrective action program for the CCR unit, summarizes key actions completed, describes any problems encountered, discusses actions to resolve the problems, and projects key activities for the upcoming year. At a minimum, the annual report must contain the following information, to the extent available:

- 1. A map, aerial image, or diagram showing the CCR unit and all background (or upgradient) and downgradient monitoring wells, to include the well identification numbers, that are part of the groundwater monitoring program for the CCR unit.
- 2. Identification of any monitoring wells that were installed or decommissioned during the preceding year, along with a narrative description of why those actions were taken.
- 3. In addition to all the monitoring data obtained under §§ 257.90 through 257.98, a summary including the number of groundwater samples that were collected for analysis for each background and downgradient well, the dates the samples were collected, and whether the sample was required by the detection monitoring or assessment monitoring programs.
- 4. A narrative discussion of any transition between monitoring programs (e.g., the date and circumstances for transitioning from detection monitoring to assessment monitoring in addition to identifying the constituent(s) detected at a statistically significant increase over background levels).
- 5. Other information required to be included in the annual report as specified in §§ 257.90 through 257.981.

This report provides the required information for the Wood River Primary East Ash Pond for calendar year 2018.

¹ For calendar year 2018, corrective action and other information required to be included in the annual report as specified in §§ 257.96 through 257.98 is not applicable.



SECTION 2: MONITORING AND CORRECTIVE ACTION PROGRAM STATUS

Detection Monitoring Program sampling event dates and parameters collected are provided in the detection monitoring program summary table below. One sample was collected from each background and downgradient well in the monitoring system during each sampling event. Analytical data was evaluated after each event in accordance with the Statistical Analysis Plan, Wood River Power Station, Dynegy Midwest Generation, LLC (NRT/OBG, 2017a) to identify any statistically significant increases (SSIs) of Appendix III parameters over background concentrations. The sampling event and whether SSIs were identified are provided in the detection monitoring program summary table below.

Detection Monitoring Program Summary

Sampling Dates	Parameters Collected	SSIs	Assessment Monitoring Program Established
November 2 and 3, 2017	Appendix III	Yes	April 9, 2018

Alternate source evaluations were inconclusive for one or more of the SSIs. Consequently, and in accordance with 40 CFR § 257.94(e)(2), an Assessment Monitoring Program was established for the Wood River Primary East Ash Pond on April 9, 2018 and the required notifications completed.

The first Assessment Monitoring sampling event was completed on May 2, 2018. One sample was collected from each background and downgradient well in the monitoring system and analyzed for Appendix III and Appendix IV parameters. In accordance with 40 CFR § 257.95(d)(1), all wells were resampled on July 31, 2018 for all Appendix III parameters and Appendix IV parameters detected during the first Assessment Monitoring sampling event. One sample was collected from each background and downgradient well in the monitoring system. Analytical data from the resampling event was evaluated in accordance with the statistical analysis plan (NRT/OBG, 2017a) to determine any SSIs of Appendix III parameters over background concentrations or statistically significant levels (SSLs) of Appendix IV parameters over Groundwater Protection Standards (GWPSs). The assessment monitoring program summary table below provides a summary of the Assessment Monitoring Program and results of SSL determinations.

Assessment Monitoring Program Summary

Sampling Dates	Parameters Collected	SSLs			
May 2, 2018	Appendix III Appendix IV	Not Applicable			
July 31, 2018	Appendix III Appendix IV Detected	To Be Determined			

Statistical background values are provided in Table 1 and GWPSs in Table 2. Analytical results from the events summarized in the detection and assessment monitoring summary tables above are included in Tables 3 and 4.

The Wood River Primary East Ash Pond remains in the Assessment Monitoring Program in accordance with 40 CFR § 257.95.



SECTION 3: KEY ACTIONS COMPLETED IN 2018

Two groundwater monitoring events were completed in 2018 under the Assessment Monitoring Program. These events occurred in May and July, and are detailed in Section 2. One groundwater sample was collected from each background and downgradient well in the monitoring system during each event. All samples were collected and analyzed in accordance with the Sampling and Analysis Plan (NRT/OBG, 2017b). All monitoring data obtained under 40 CFR §§ 257.90 through 257.98 (as applicable) in 2018 are presented in Tables 3 and 4.

The groundwater monitoring system, including the CCR unit and all background and downgradient monitoring wells, is presented in Figure 1.





SECTION 4: PROBLEMS ENCOUNTERED AND ACTIONS TO RESOLVE THE PROBLEMS

No problems were encountered with the groundwater monitoring program during 2018. Groundwater samples were collected and analyzed in accordance with the Sampling and Analysis Plan (NRT/OBG, 2017b), and all data was accepted.





SECTION 5: KEY ACTIVITIES PLANNED FOR 2019

The following key activities are planned for 2019:

- Continuation of the Assessment Monitoring Program with semi-annual sampling scheduled for the first and third quarters of 2019.
- Complete evaluation of analytical data from the downgradient wells, using GWPSs to determine whether an SSL of Appendix IV parameters has occurred.
- If an SSL is identified, potential alternate sources (i.e., a source other than the CCR unit caused the SSL or that SSL resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality) will be evaluated. If an alternate source is demonstrated to be the cause of the SSL, a written demonstration will be completed within 90 days of SSL determination and included in the annual groundwater monitoring and corrective action report for 2019.
 - » If an alternate source(s) is not identified to be the cause of the SSL, the applicable requirements of 40 CFR §§ 257.94 through 257.98 (e.g., assessment of corrective measures) as may apply in 2019 will be met, including associated recordkeeping/notifications required by 40 CFR §§ 257.105 through 257.108.



REFERENCES


Natural Resource Technology, an OBG Company, 2017a, Statistical Analysis Plan, Baldwin Energy Complex, Havana Power Station, Hennepin Power Station, Wood River Power Station, Dynegy Midwest Generation, LLC, October 17, 2017.

Natural Resource Technology, an OBG Company, 2017b, Sampling and Analysis Plan, Wood River Primary East Ash Pond, Wood River Power Station, Alton, Illinois, Project No. 2285, Revision 0, October 17, 2017.





Figures

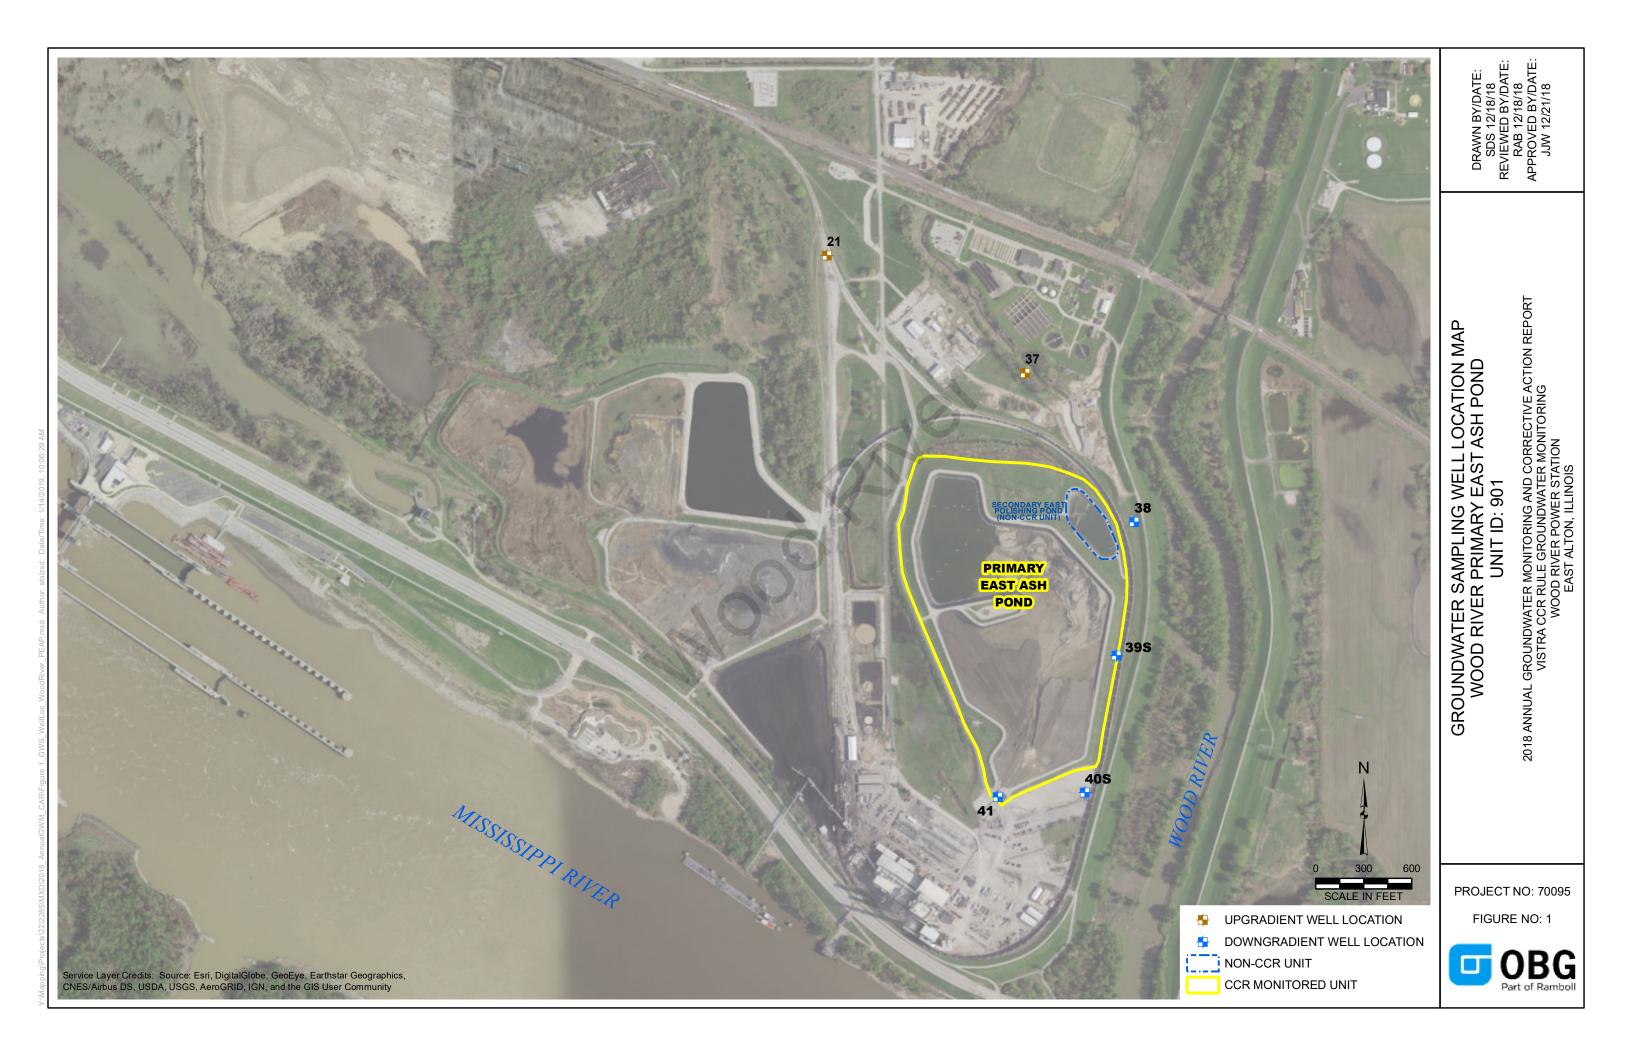

Tables

Table 1. Statistical Background Values

2018 Annual Groundwater Monitoring and Corrective Action Report Wood River Power Station Unit ID 901 - Wood River Primary East Ash Pond

Parameter	Statistical Background Value					
Appe	endix III					
Boron (mg/L)	1.22					
Calcium (mg/L)	180.516					
Chloride (mg/L)	88					
Fluoride (mg/L)	0.76					
pH (S.U.)	6.61 / 7.23					
Sulfate (mg/L)	203					
TDS (mg/L)	863					

[O: KLS 8/29/18, C: RAB 8/30/18]

Notes:

mg/L = milligrams per liter

S.U. = Standard Units

TDS = Total Dissolved Solids



Table 2. Groundwater Protection Standards

2018 Annual Groundwater Monitoring and Corrective Action Report Wood River Power Station Unit ID 901 - Wood River Primary East Ash Pond

Parameter	Groundwater Protection Standard				
Appendix	cIV				
Antimony (mg/L)	0.006				
Arsenic (mg/L)	0.01				
Barium (mg/L)	2				
Beryllium (mg/L)	0.004				
Cadmium (mg/L)	0.005				
Chromium (mg/L)	0.10				
Cobalt (mg/L)	0.006				
Fluoride (mg/L)	4				
Lead (mg/L)	0.015				
Lithium (mg/L)	0.0409				
Mercury (mg/L)	0.002				
Molybdenum (mg/L)	0.10				
Selenium (mg/L)	0.05				
Thallium (mg/L)	0.002				
Radium 226+228 (pCi/L)	5				

[O: KLS 8/29/18, C: RAB 8/30/18]

Notes:

mg/L = milligrams per liter pCi/L = picoCuries per liter



Table 3. Appendix III Analytical Results

2018 Annual Groundwater Monitoring and Corrective Action Report Wood River Power Station Unit ID 901 - Wood River Primary East Ash Pond

Sample Location	Date Sampled	B, total (mg/L)	Ca, total (mg/L)	Cl, total (mg/L)	F, total (mg/L)	pH (field) (S.U.)	SO4, total (mg/L)	TDS (mg/L)				
Background / Upgradient Monitoring Wells												
	11/3/2017	0.338	111	<5	0.18	7.5	76	472				
21	5/2/2018	0.397	128	5	0.18	6.4	69	456				
	7/31/2018	0.328	106	<5	0.18	6.9	57	448				
	11/2/2017	0.869	140	59	0.51	7.1	103	602				
37	5/2/2018	0.618	134	45	0.54	6.5	99	644				
	7/31/2018	0.475	163	11	0.50	6.7	69	528				
Downgradient Monitoring Wells												
	11/2/2017	1.18	69.4	44	<0.1	7.6	80	384				
38	5/2/2018	3.12	94.1	43	0.3	6.7	130	500				
	7/31/2018	2.69	102	45	0.31	7.2	94	438				
	11/2/2017	59.4	212	< 5	0.48	7.5	481	1050				
395	5/2/2018	51.2	241	5	0.46	6.5	515	1080				
	7/31/2018	61.1	344	<5	0.40	6.8	509	1150				
	11/3/2017	25.1	236	10	0.14	7.6	548	1040				
40S	5/2/2018	18.8	259	14	0.20	6.3	408	1140				
	7/31/2018	27.3	360	10	0.10	7.1	604	1210				
	11/3/2017	8.07	293	18	0.15	7.5	642	1340				
41	5/2/2018	10.4	324	12	0.14	6.3	940	1620				
	7/31/2018	10.1	441	22	0.14	7.0	1000	1800				

[O: RAB 12/27/18, C: JQW 12/27/18]

Notes:

mg/L = milligrams per liter

S.U. = Standard Units

TDS = Total Dissolved Solids

< = concentration is less than the reporting limit



Table 4. Appendix IV Analytical Results

2018 Annual Groundwater Monitoring and Corrective Action Report Wood River Power Station Unit ID 901 - Wood River Primary East Ash Pond

Sample Location	Date Sampled	Sb, total (mg/L)	As, total (mg/L)	Ba, total (mg/L)	Be, total (mg/L)	Cd, total (mg/L)	Cr, total (mg/L)	Co, total (mg/L)	F, total (mg/L)	Pb, total (mg/L)	Li, total (mg/L)	Hg, total (mg/L)	Mo, total (mg/L)	Ra226/228 Combined (pCi/L)	Se, total (mg/L)	Tl, total (mg/L)
Backgrour	Background / Upgradient Monitoring Wells															
21	5/2/2018	0.0010	0.0023	0.204	<0.001	0.001	<0.0015	0.001	0.18	<0.001	0.0117	<0.0002	0.0015	1.50	0.0021	<0.002
	7/31/2018ª	<0.001	0.0023	0.176	NA	<0.001	NA	<0.001	0.18	NA	0.0093	<0.0002	<0.0015	0.17	<0.001	NA
37	5/2/2018	<0.001	0.0010	0.106	<0.001	<0.001	<0.0015	0.001	0.54	<0.001	0.0315	<0.0002	0.0034	1.59	<0.001	<0.002
3,	7/31/2018 ^a	<0.001	<0.001	0.121	NA	<0.001	NA	<0.001	0.50	NA	0.0251	<0.0002	0.0034	0.00	<0.001	NA
Downgrad	lient Monito	ring Wells														
38	5/2/2018	<0.001	<0.001	0.151	<0.001	<0.001	<0.0015	<0.001	0.30	<0.001	0.0135	<0.0002	0.076	1.23	<0.001	<0.002
	7/31/2018ª	<0.001	<0.001	0.167	NA	<0.001	NA	<0.001	0.31	NA	0.0135	<0.0002	0.128	0.53	<0.001	NA
395	5/2/2018	<0.001	0.0014	0.0317	<0.001	0.001	<0.0015	0.001	0.46	<0.001	0.0138	<0.0002	0.931	1.90	<0.001	<0.002
393	7/31/2018 ^a	<0.001	0.0020	0.0496	NA	<0.001	NA	0.0012	0.40	NA	0.0129	<0.0002	1.05	0.07	<0.001	NA
40S	5/2/2018	0.0011	0.0010	0.104	<0.001	0.001	<0.0015	0.0016	0.20	<0.001	0.026	0.00025	0.0925	0.88	0.0039	<0.002
403	7/31/2018 ^a	0.0021	0.0010	0.113	NA	<0.001	NA	0.0012	0.10	NA	0.0599	<0.0002	0.195	0.56	0.0062	NA
41	5/2/2018	<0.001	<0.001	0.0296	<0.001	0.001	<0.0015	0.001	0.14	<0.001	0.0288	<0.0002	0.036	0.43	0.001	<0.002
41	7/31/2018 ^a	<0.001	<0.001	0.0327	NA	<0.001	NA	<0.001	0.14	NA	0.0366	<0.0002	0.0506	0.00	0.002	NA

[O: RAB 12/27/18, C: JQW 12/27/18, U: AJB 1/28/19]

Notes:

mg/L = milligrams per liter

pCi/L = picoCuries per liter

NA = Not Analyzed

< = concentration is less than the reporting limit

^aOnly the parameters detected during the previous sampling event were analyzed during this sampling event, in accordance with 40CFR § 257.95(d)(1).

